

RamSoft Client Integration Specification

Version 6.0



All Information provided in this document and in the accompanying software is subject to change without notice and does not represent a commitment on the part of RamSoft. RamSoft assumes no responsibility for any errors or consequential damages that may result from the use or misinterpretation of any information in this document. No part of this document may be reproduced in any form or by any means, electronic or mechanical, including photocopying and recording, for any purpose without the express written permission of RamSoft.

MANUFACTURER

RamSoft Incorporated
700-60 Adelaide St E
Toronto, ON M5C 3E4
CANADA

Toll Free: (888) 343-9146
Phone: (416) 674-1347
Fax: (416) 674-7147
Email: support@ramsoft.com
Web Site: <http://www.ramsoft.com>

RamSoft®, RamSoft PACS™ are registered trademark of RamSoft Inc.

PowerServer™, PowerReader™, PowerCache™, Essence™, RapidResults™ and Gateway™ are registered trademarks of RamSoft Inc.

Microsoft® and Windows® are registered trademarks of Microsoft Corporation.

M*Modal Speech Understanding™ is a registered trademark of MModal IP LLC.

Dragon Medical® is a registered trademark of Nuance Communications, Inc.

RamSoft Client Integration Specification

1	OVERVIEW	1
2	URL INTEGRATION	2
2.1	Format of PowerReader URL	2
2.2	Format of the RapidResults URL	2
2.3	URL Parameters	3
2.4	Launch Study Options	5
2.5	Example URLs	5
2.5.1	PowerReader URL Examples	5
2.5.2	RapidResults URL Examples	6
2.5.2.1	Study URL	6
2.5.2.2	Study URL without logging in	6
2.5.2.3	Reports URL	7
2.6	Notes	7
3	TCP/IP XML INTEGRATION	8
3.1	TCP/IP Configuration	8
3.2	XML Message Format that PowerReader can Send and Receive	9

1 OVERVIEW

The purpose of this document is to provide the client integration specifications for PowerServer 6.0 software from RamSoft Inc.

2 URL INTEGRATION

2.1 Format of PowerReader URL

The PowerReader URL is of the form:

```
https://[serverurl]/powerreader/login.aspx?app=powerreader&param1=value1&param2=value2...
```

When the above URL is executed, the PowerReader web-page will download the PowerReader client if necessary and launch PowerReader or execute on an existing instance for the same server if already running.

2.2 Format of the RapidResults URL

The RapidResults URL is of the form:

```
http://[serverurl]/ powerreader/login.aspx?app=rapidresults&param1=value1&param2=value2&...
```

Direct access to the RapidResults URL is of the form:

```
http://[serverurl]/ powerreader/mobile/index.aspx?param1=value1&param2=value2&...
```

2.3 URL Parameters

NOTE: All parameters below will work in PowerReader and RapidResults unless specified otherwise.

Parameter	PowerReader Support	RapidResults Support	Description
Username	✓	✓	This parameter specifies the user context to use for PowerReader and RapidResults.
Password	✓	✓	<p>This parameter specifies the password for the user context. If the password is not entered and PowerReader is not running or if the user context has changed, the login page will appear prompting the user to enter their password before it executes the URL command. If PowerReader is running, the existing instance and user context will be used if the username value matches.</p> <p>RapidResults performs the same user context checking as well. RapidResults always launches a new browser session.</p> <div style="border: 1px solid black; padding: 2px; margin-top: 10px;"> <p>Note: This value is case sensitive.</p> </div>
Patientid	✓	✓	This parameter specifies the Patient ID for the patient being opened or added.
Accessionnumber	✓	✓	This parameter specifies the Accession Number of the study being opened.
Studyuid	✓	✓	This parameter specifies the Study Instance UID of the study being opened.
Issuer	✓	✓	This parameter specifies the Issuer of Patient ID of the study being opened.
Action	✓		<p>This parameter specifies a specific action to perform. The valid values are <i>close</i> (to close PowerReader) and <i>closestudy</i> (to close the currently displayed study).</p> <div style="border: 1px solid black; padding: 2px; margin-top: 10px;"> <p>Note: This parameter should not be specified to open a study.</p> </div>

Sessionid		✓	This parameter specifies the session id to open RapidResults for authentication purpose. SessionID is an alternative to providing username and password.
ViewDiagSROnly		✓	This parameter specifies RapidResults to only show diagnostic reports when opening a study.
PatientIDIssuer		✓	This is a special parameter which is a combination of patient ID + Issuer. This was originally designed for PracticeSuite.

2.4 Launch Study Options

To open a study, the following options are available:

- i. Specifying only the **patientid** will open the most recent study of the Patient that matches with the specified Patient ID.
- ii. Specifying only the **patientid** and **issuer** will open the most recent study of the Patient that matches with the specified Patient ID and Issuer of Patient ID combination.
- iii. Specifying **patientid** and **accessionnumber** will open the study with the corresponding Patient ID and Accession Number combination.
- iv. Specifying **studyuid** will open the study with the corresponding Study Instance UID.
- v. Specifying **patientid**, **accessionnumber**, and **issuer** will open the study with the corresponding Patient ID, Accession Number, and Issuer of Patient ID combination. This can help differentiate between two or more studies which has the same Patient ID and Accession Number.

Note: If a study cannot be located, the Worklist will appear instead in PowerReader or the search screen will display in RapidResults.

2.5 Example URLs

Copy and paste the URLs below into a browser to see how they work (may not work directly clicking them in this document).

2.5.1 PowerReader URL Examples

The URL below will open the study with Accession Number ACCECHO2 and Patient ID ID990023 under the user context of the user "testuser":

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&patientid=ID990023&accessionnumber=ACCECHO2&app=powerreader>

The URL below will open the study with Accession Number ACCECHO2, Patient ID ID990023, and Issuer 'RAMSOFT' under the user context of the user "testuser":

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&patientid=ID990023&accessionnumber=ACCECHO2&issuer=RAMSOFT&app=powerreader>

The URL below will open the study with a Study Instance UID of 1.76.380.18.14.1161018173229151.156 under the user context of the user “testuser”:

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&studyuid=1.76.380.18.14.1161018173229151.156&app=powerreader>

This URL below will close the currently opened study under the user context of the user “testuser”:

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&action=closestudy>

2.5.2 RapidResults URL Examples

2.5.2.1 Study URL

The URL below will open the study with Accession Number ACCECHO2 and Patient ID ID990023 under the user context of the user “testuser”:

<http://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&patientid=ID990023&accessionnumber=ACCECHO2&app=rapidresults>

The URL below will open the study with Accession Number ACCECHO2, Patient ID ID990023, and Issuer ‘RAMSOFT’ under the user context of the user “testuser”:

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&patientid=ID990023&accessionnumber=ACCECHO2&issuer=RAMSOFT&app=rapidresults>

The URL below will open the study with a Study Instance UID of 1.76.380.18.14.1161018173229151.156 under the user context of the user “testuser”:

<https://betademo.ramsoft.com/powerreader/login.aspx?username=testuser&password=Ramsoft11!!&studyuid=1.76.380.18.14.1161018173229151.156&app=rapidresults>

2.5.2.2 Study URL without logging in

The URL (with the required Study UID and Patient ID) below will allow any user to access a study within RapidResults without the need to log in.

<http://betademo.ramsoft.com/powerreader/mobile/index.aspx?studyuid=1.76.380.18.14.1161018173229151.156&patientid=ID990001>

2.5.2.3 Reports URL

The URL below will display a list of diagnostic reports for a study with Accession Number RAM0016067 and Patient ID ID990003.

<http://betademo.ramsoft.com/powerreader/mobile/index.aspx?sessionid={31D90BFE-BACA-E64A-BD1E-D8B0FE754490}&patientid=ID990003&accessionnumber=RAM0016067&ViewDiagSROnly=true>

The URL below will display a list of diagnostic reports for a study with Accession Number RAM0016067 and a combined Patient ID and Issuer of ID990003RAMSOFT (Patient ID: ID990003 and Issuer: RAMSOFT):

<http://betademo.ramsoft.com/powerreader/mobile/index.aspx?sessionid={31D90BFE-BACA-E64A-BD1E-D8B0FE754490}patientidissuer=ID990003RAMSOFT&accessionnumber=RAM0016067&ViewDiagSROnly=true>

Note that the sessionid provided in the examples above varies from sessions and is provided here for illustrations only; only applications within the RamSoft Login Portal may use this format. Applications outside of the RamSoft Login Portal must use formats in the Study URL examples above and manually launch Reports in RapidResults.

When using combined Patient ID and Issuer. Patient ID must end in a digit (e.g. RAM4905) while the Issuer should not start with a digit (e.g. RAMSOFT).


2.6 Notes

1. PowerReader Integration URLs can be launched in different browsers (e.g. IE, Chrome). Please refer to the platform specification for details, <https://www.ramsoft.com/support/resources/conformance-statements-resources/>
2. It is advised that the same web browser window be re-used to execute **ALL** URL commands.
3. HTTPS POST should be used while calling the PowerServer URL to encrypt all parameters. Placing the parameters in the URL (GET) will transmit all parameters unencrypted.

3 TCP/IP XML INTEGRATION

3.1 TCP/IP Configuration

TCP/IP XML Integration is configured in PowerReader via Settings > Client Integration > TCP/IP XML Integration.

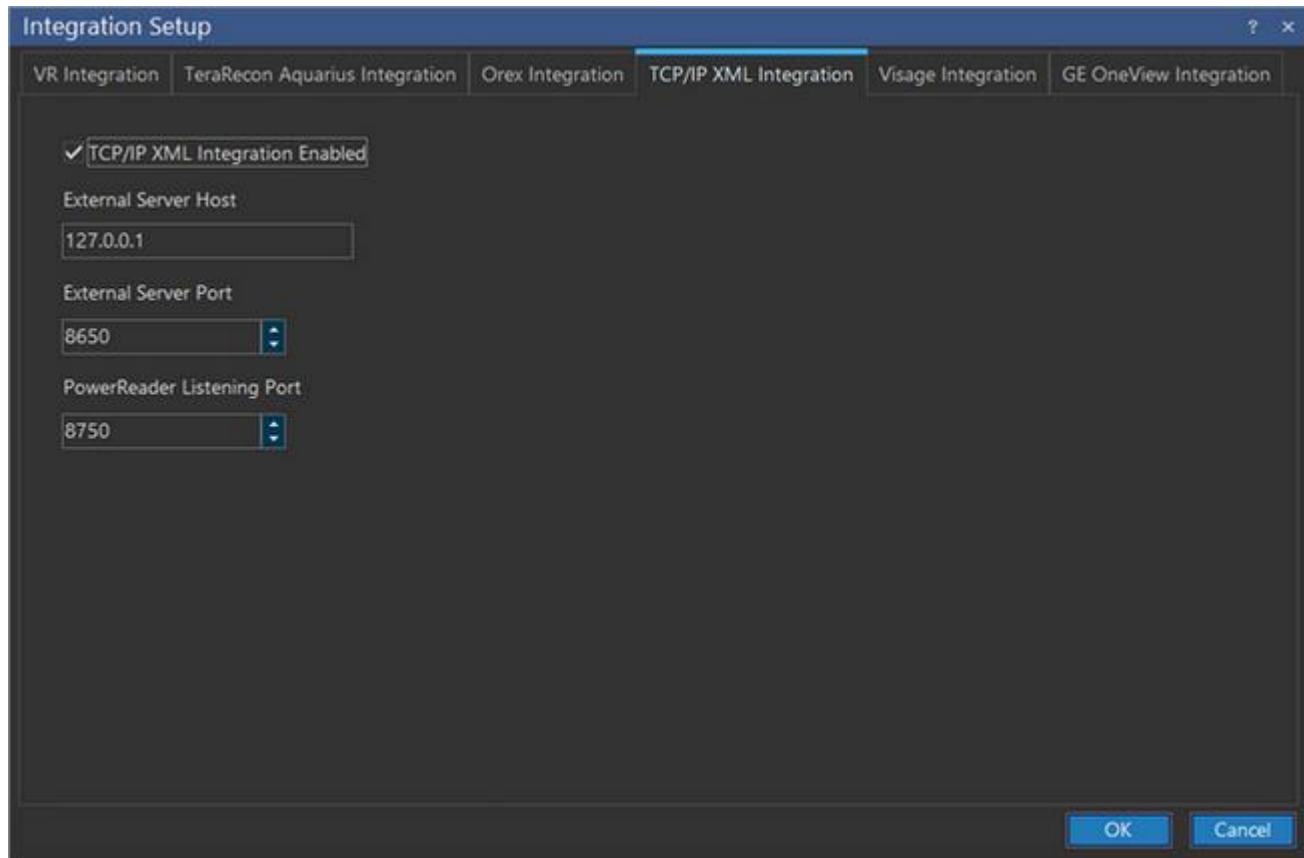

- **External Server Host** and **External Server Port** are configured to allow PowerReader to send XML messages to another system.
- **PowerReader Listening Port** is the TCP/IP Port that PowerReader will use to receive XML messages from another system.

The client workstation firewall must be configured to open the configured TCP/IP ports.

3.2 XML Message Format that PowerReader can Send and Receive

```
<?xml version="1.0" encoding="utf-8"?>
<XAppMessage>
  <MessageInfo>
    <Type Type="String">Request</Type>
    <Command Type="String">OpenPatient</Command>
    <Sender>
      <Name Type="String">%APPNAME%</Name>
    </Sender>
    <UID Type="String">%UID%</UID>
  </MessageInfo>

  <Patient>
    <PatientID Type="String">%PATIENTID%</PatientID>
    <Study>
      <AccessionNumber Type="String">%ACCESSIONNUMBER%</AccessionNumber>
    </Study>
  </Patient>

  <UserID>%USERNAME%</UserID>
</XAppMessage>
```

These strings will be replaced with data from PowerReader:

%APPNAME%	This field is populated with the PowerReader caption when sending. When receiving, this field is ignored.
%UID%	This field is populated with a DICOM UID when sending to uniquely identify this message. When receiving, this field is ignored.
%PATIENTID%	This field is populated with the Patient's ID.
%ACCESSIONNUMBER%	This field is populated with the study's Accession Number.
%USERNAME%	This field is populated with the currently logged in User Name when sending. When receiving, this field is ignored.

VERSIONS

Version	Revision Notes	Updated by	Reviewed by	Effective Date
Rev A	Updated the document in new template. Added point #2 in section 2.5	UKN	LLG	1/28/2013
Rev B	Added sections 2.2 'Format of Physician Portal URL' and section 2.5.2 'Physician Portal URL Examples'.	UKN	LLG	2/25/2013
Rev C	Added sections 2.3 'Format of Mobile Physician Portal URL' and section 2.5.3 'Mobile Physician Portal URL Examples'. Also added Issuer to the Parameter list in section 2.4.	HGA	SRN	3/7/2013
Rev D	Added section 3 on TCP/IP XML Integration	TCN	SRN	3/26/2013
Rev E	<ul style="list-style-type: none"> • Removed Physician Portal. • Updated rebrand name RapidResults • Updated Heading of document from "PowerReader Client Integrations" to "RamSoft Client Integration Specification 6.0". • Removed 5.1 R3 notes. • Added SessionID and ViewdiagSROnly into Parameters Table • Updated 2.5.2 last example to launch RapidResults with SessionID, PatientID and Accessionnumber 	TCN	SRN	11/20/2013
Rev F	<ul style="list-style-type: none"> • Modified all "powerreader4" in sample URLs to just "powerreader" • Removed reference to RapidResults' login page under the "password" section • Added new parameter "PatientIDIssuer" 	HGA	TCN	6/17/2015
Rev G	<ul style="list-style-type: none"> • Updated URLs under "RapidResults URL Examples" to launch studies in RapidResults • Split RapidResults Example URL section into 3 different sections 	HGA	TCN	8/21/2015
Rev H	<ul style="list-style-type: none"> • Fixed an error in the first RapidResults URL example (Acession #, PatientID) 	HGA	RSA	10/09/2015

Rev I	<ul style="list-style-type: none"> Updated the screenshot for Integration Setup screen 	LLH	DVR	11/18/2015
Rev J	<ul style="list-style-type: none"> Study UID and Patient ID are required information to access study without logging in Include that other browsers can be used to launch URLs with link to RamSoft Platform Specifications Explanation when combining Patient ID and Issuer in URL 	RGO	LLG	2/22/2016
Rev K	<ul style="list-style-type: none"> Updated Example URLs section to point to working demo server 	JZG		7/31/2018
Rev L	<ul style="list-style-type: none"> Revised Username / Password in Example URLs Revised wording of URL integration section 	JZG	LLG	8/16/2018